


Air density (γ): 1.20 kg/m³
 Installation type "B": free inlet, ducted outlet
 12000 m³/h fan test chamber according to AMCA 210/05 fig. 12
 Free field Lp(A) measurements at 1 m according to ISO 3746:2011

Unit type:
Test nr.: 2924
Date: 2018/05/31
Power supply[V]: 230 1~
Frequency [Hz]: 50

Motor code: 2011017
Motor power [W]: 420
Motor poles: 4
Mot. prot. class: IP55
Mot. ins. class: F

Motor Th. Prot.: YES IN
Capacitor [μ F]: 8
Unit max. abs. current [A]: 3,3
Unit max. abs. power [W]: 760

ErP status: ErP 2018

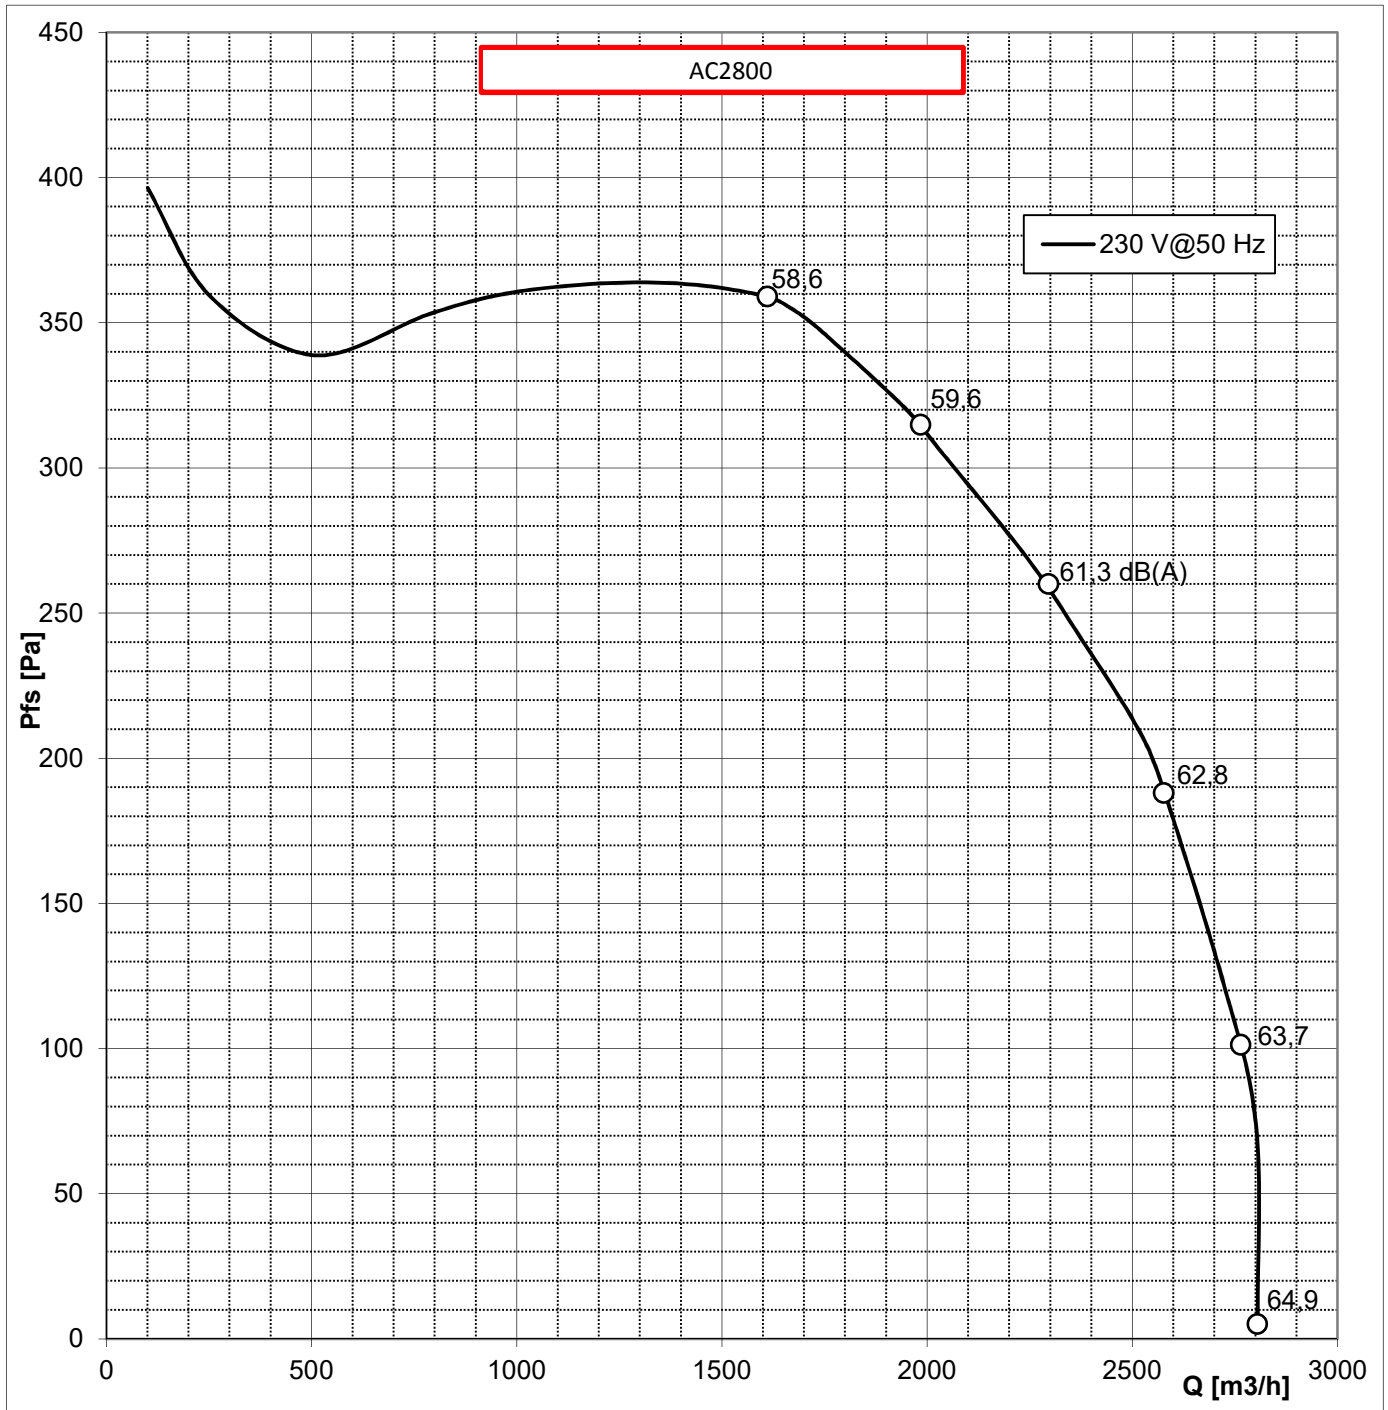

Data are not certified by AMCA

Air density (γ): 1.20 kg/m³
Installation type "B": free inlet, ducted outlet
12000 m³/h fan test chamber according to AMCA 210/05 fig. 12
Free field Lp(A) measurements at 1 m according to ISO 3746:2011

Unit type:
Test nr.: 2924
Date: 2018/05/31
Power supply[V]: 230 1~
Frequency [Hz]: 50

Motor code: 2011017
Motor power [W]: 420
Motor poles: 4
Mot. prot. class: IP55
Mot. ins. class: F

Motor Th. Prot.: YES IN
Capacitor [μ F]: 8
Unit max. abs. current [A]: 3,3
Unit max. abs. power [W]: 760

ErP status: ErP 2018

