


Air density ( $\gamma$ ): 1.20 kg/m<sup>3</sup>  
Installation type "B": free inlet, ducted outlet  
12000 m<sup>3</sup>/h fan test chamber according to AMCA 210/05 fig. 12  
Free field Lp(A) measurements at 1 m according to ISO 3746:2011

Unit type:  
Test nr.: 2294  
Date: 2017/04/05  
Power supply[V]: 230 1~  
Frequency [Hz]: 50

Motor code: 2011018  
Motor power [W]: 550  
Motor poles: 4  
Mot. prot. class: IP44  
Mot. ins. class: F

Motor Th. prot: YES IN  
Capacitor [ $\mu$ F]: 12,5  
Unit max. abs. current [A]: 6,2  
Unit max. abs. power [W]: 1370

ErP status: ErP 2018

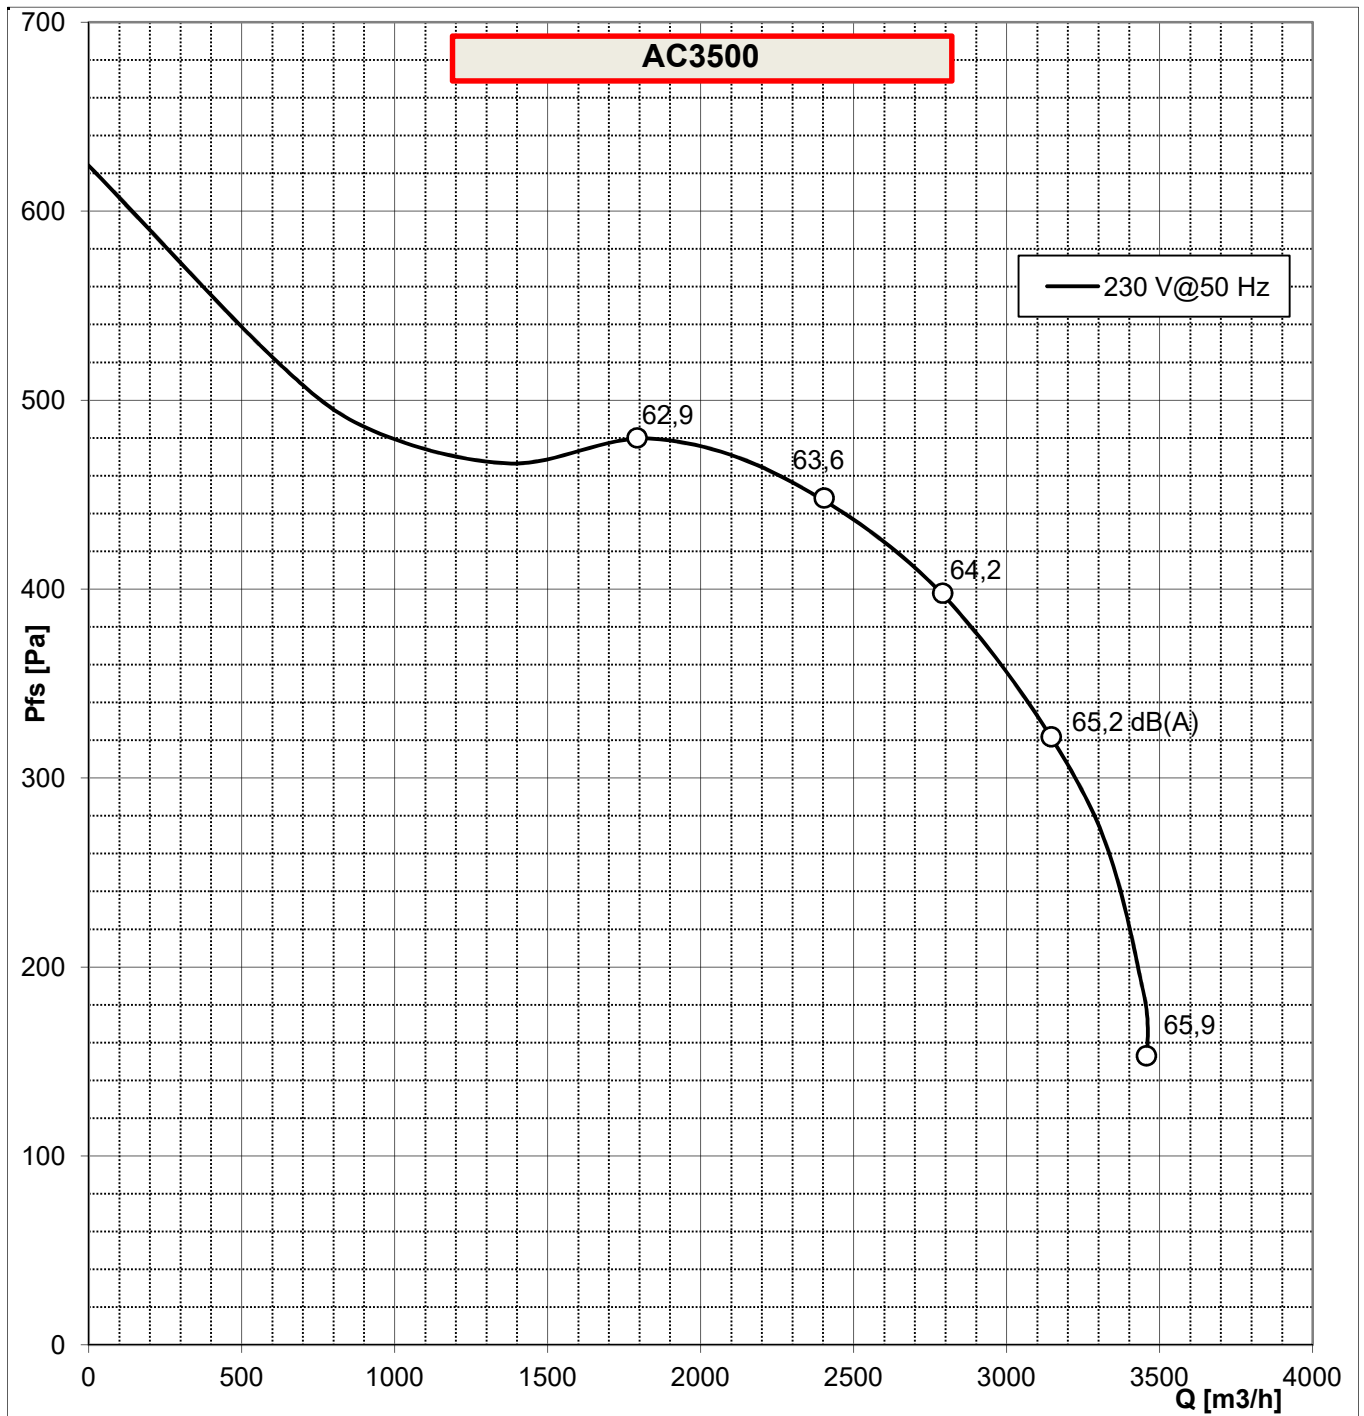

Data are not certified by AMCA

Air density ( $\gamma$ ): 1.20 kg/m<sup>3</sup>  
Installation type "B": free inlet, ducted outlet  
12000 m<sup>3</sup>/h fan test chamber according to AMCA 210/05 fig. 12  
Free field Lp(A) measurements at 1 m according to ISO 3746:2011

Unit type: 2294  
Test nr.: 2017/04/05  
Date: 230 1~  
Power supply[V]: 50  
Frequency [Hz]:

Motor code: 2011018  
Motor power [W]: 550  
Motor poles: 4  
Mot. prot. class: IP44  
Mot. ins. class: F

Motor Th. prot: YES IN  
Capacitor [ $\mu$ F]: 12,5  
Unit max. abs. current [A]: 6,2  
Unit max. abs. power [W]: 1370

ErP status: ErP 2018

