


Air density (γ): 1.20 kg/m³
 Installation type "B": free inlet, ducted outlet
 12000 m³/h fan test chamber according to AMCA 210/05 fig. 12
 Free field Lp(A) measurements at 1 m according to ISO 3746:2011

Fan type:	AC8000	Motor code:	201100P	Motor T.H.:	YES OUT
Test nr.:	1911	Motor power [W]:	1100	Capacitor [μF]:	-
Date:	2016/07/06	Motor poles:	6	Max. abs. current [A]:	4,3/7,4
Power supply[V]:	400/230 3~	Mot. prot. class:	IP55	Max. abs. power [W]:	2200
Frequency [Hz]:	50	Mot. ins. class:	F		

ErP status: ErP 2018

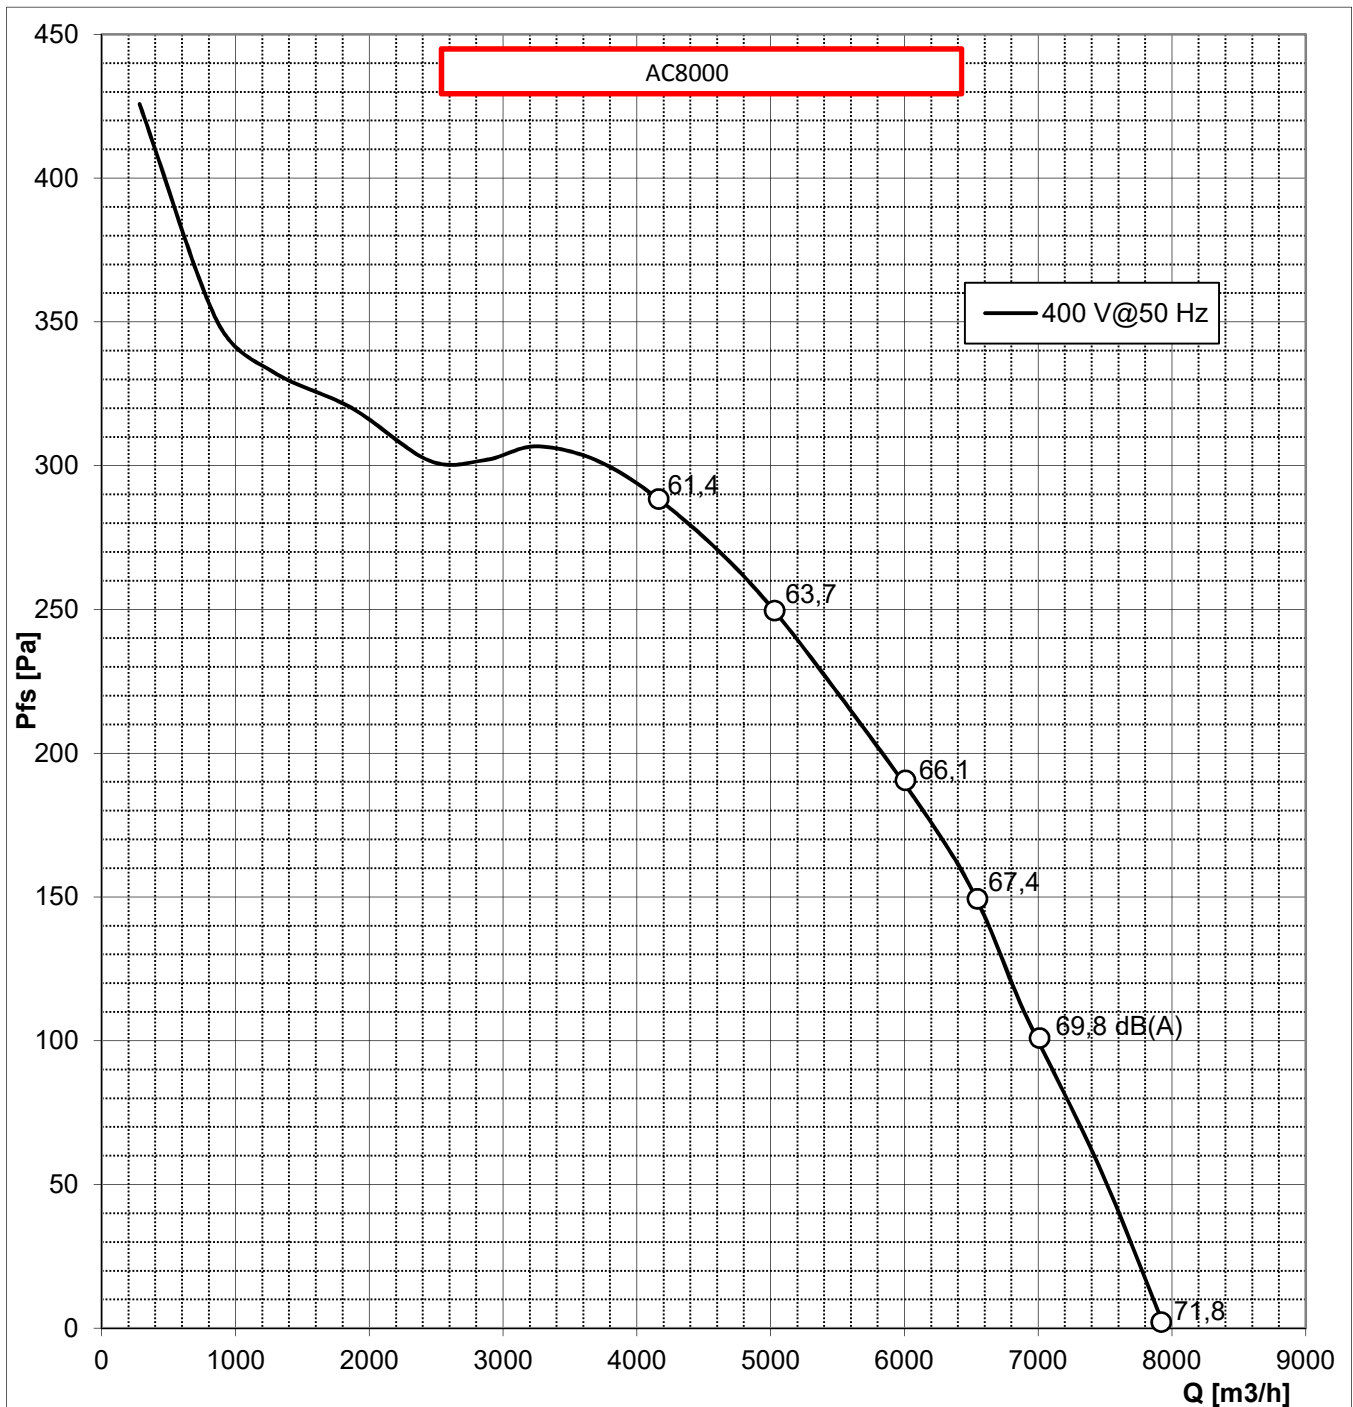

Data are not certified by AMCA

Air density (γ): 1.20 kg/m³
Installation type "B": free inlet, ducted outlet
12000 m³/h fan test chamber according to AMCA 210/05 fig. 12
Free field Lp(A) measurements at 1 m according to ISO 3746:2011

Fan type:	AC8000	Motor code:	201100P	Motor T.H.:	YES OUT
Test nr.:	1911	Motor power [W]:	1100	Capacitor [μF]:	-
Date:	2016/07/06	Motor poles:	6	Max. abs. current [A]:	4,3/7,4
Power supply[V]:	400/230 3~	Mot. prot. class:	IP55	Max. abs. power [W]:	2200
Frequency [Hz]:	50	Mot. ins. class:	F		

ErP status: ErP 2018

