


Air density (γ): 1.20 kg/m³
Installation type "B": free inlet, ducted outlet
12000 m³/h fan test chamber according to AMCA 210/05 fig. 12
Free field Lp(A) measurements at 1 m according to ISO 3746:2011

Unit type:
Test nr.: 2427
Date: 2017/06/21
Power supply[V]: 230/400 3~
Frequency [Hz]: 50

Motor code: 201100E
Motor power [W]: 2200
Motor poles: 6
Mot. prot. class: IP55
Mot. ins. class: F

Motor Th. Prot.: YES IN
Capacitor [μ F]: -
Unit max. abs. current [A]: 11,6/6,7
Unit max. abs. power [W]: 3300

ErP status: ErP 2018

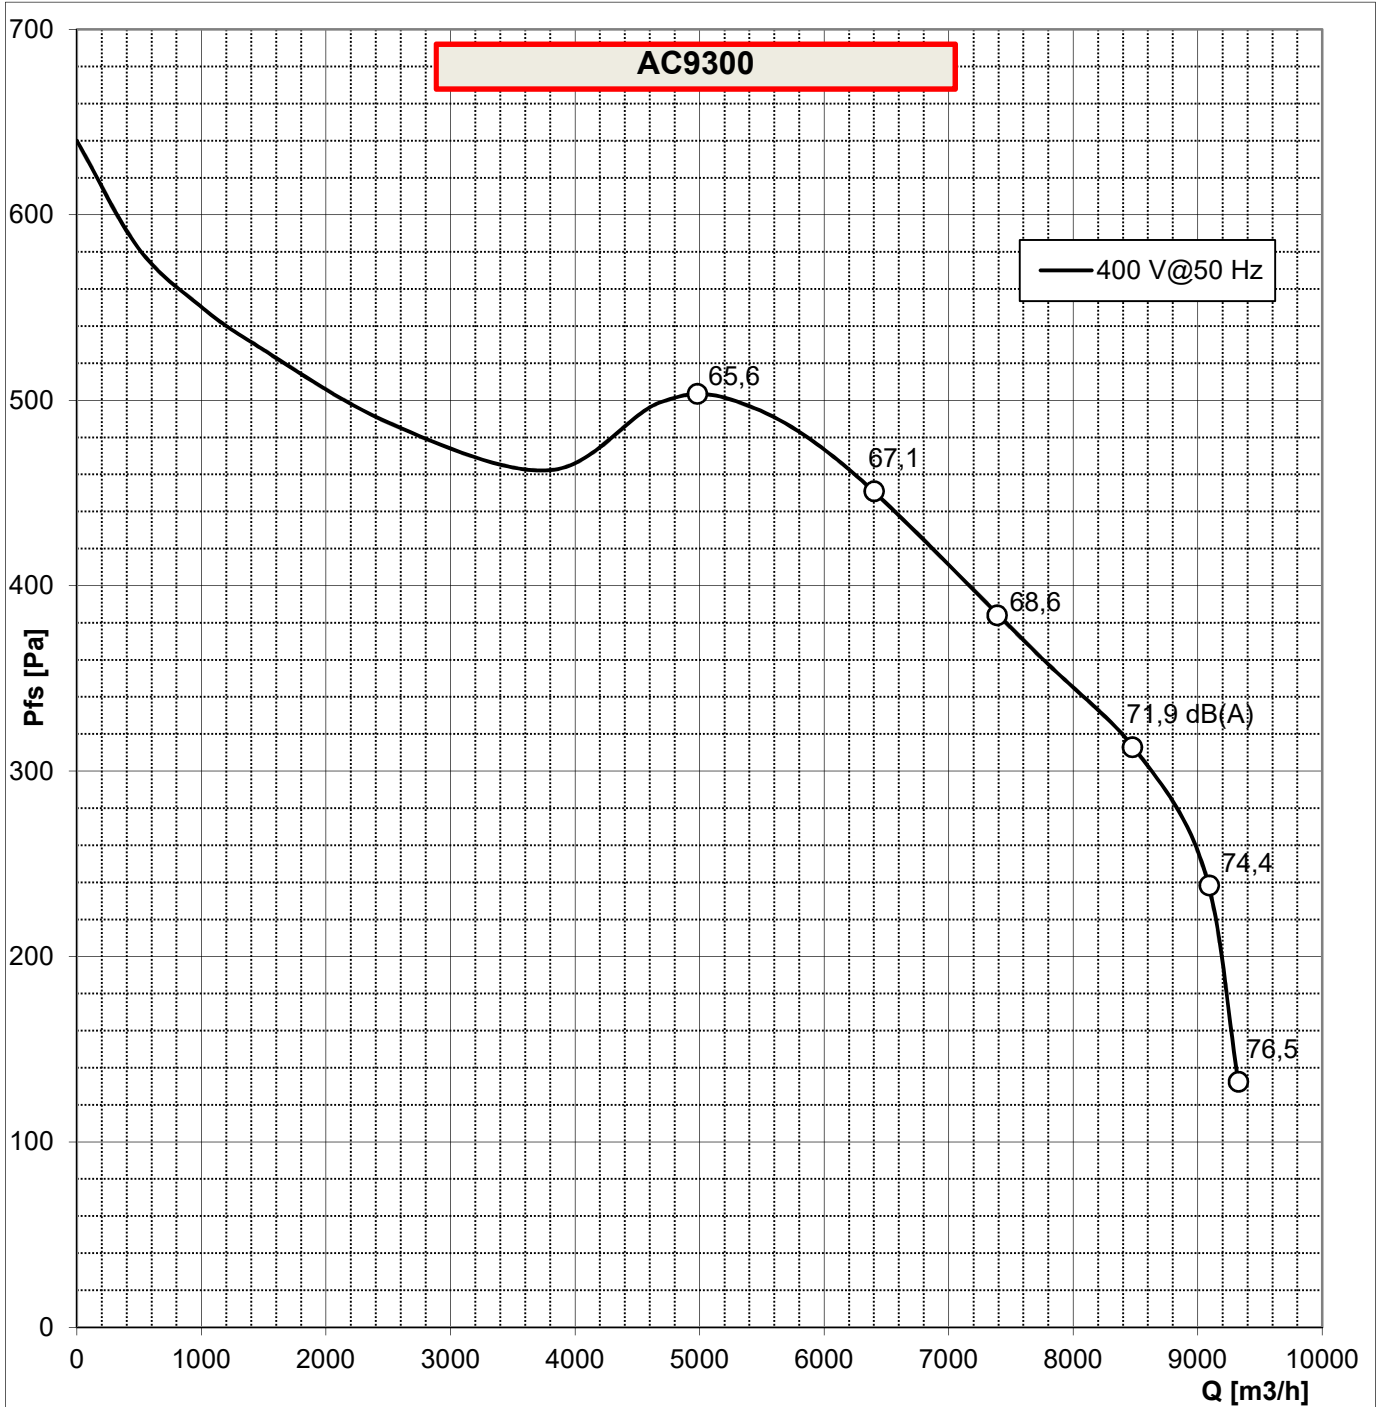

Data are not certified by AMCA

Air density (γ): 1.20 kg/m³
Installation type "B": free inlet, ducted outlet
12000 m³/h fan test chamber according to AMCA 210/05 fig. 12
Free field Lp(A) measurements at 1 m according to ISO 3746:2011

Unit type:
Test nr.: 2427
Date: 2017/06/21
Power supply[V]: 230/400 3~
Frequency [Hz]: 50

Motor code: 201100E
Motor power [W]: 2200
Motor poles: 6
Mot. prot. class: IP55
Mot. ins. class: F

Motor Th. Prot.: YES IN
Capacitor [μ F]: -
Unit max. abs. current [A]: 11,6/6,7
Unit max. abs. power [W]: 3300

ErP status: ErP 2018

