


Air density ( $\gamma$ ): 1.20 kg/m<sup>3</sup>  
Installation type "A": free inlet, free outlet  
12000 m<sup>3</sup>/h fan test chamber according to AMCA 210/05 fig. 12

<b>Fan type:</b>	VDI 8000 PRO	<b>Motor code:</b>	201100L	<b>Motor T.H.:</b>	YES IN
<b>Test nr.:</b>	1331	<b>Motor power [W]:</b>	1000	<b>Capacitor [<math>\mu</math>F]:</b>	30
<b>Date:</b>	2015/05/29	<b>Motor poles:</b>	4	<b>Fan max. abs. current [A]:</b>	5.6
<b>Power supply[V]:</b>	230 1~	<b>Mot. prot. class:</b>	IP 54		
<b>Frequency [Hz]:</b>	50	<b>Mot. ins. class:</b>	F		

**VDI 8000 PRO 201100L 1F 4P 1V**

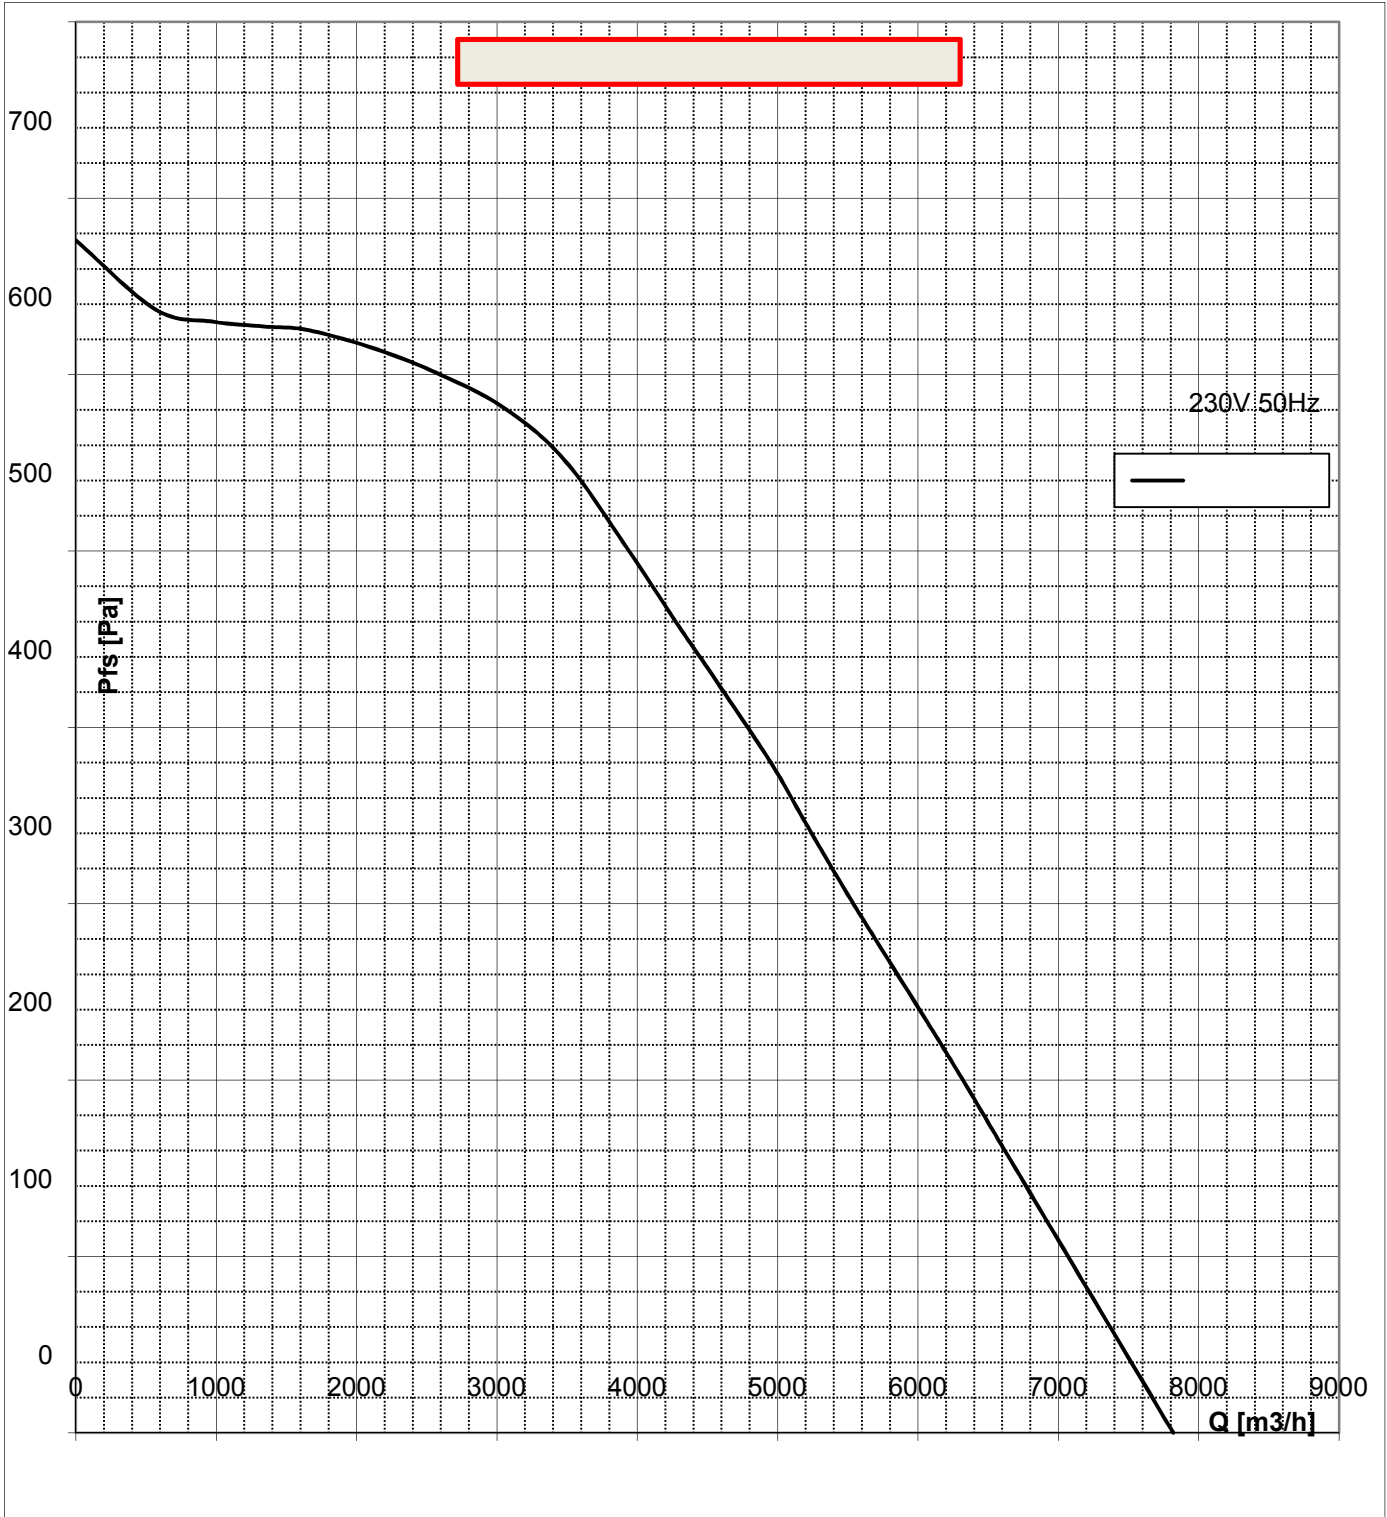

Air density ( $\gamma$ ): 1.20 kg/m<sup>3</sup>  
 Installation type "A": free inlet, free outlet  
 12000 m<sup>3</sup>/h fan test chamber according to AMCA 210/05 fig. 12

<b>Fan type:</b>	VDI 8000 PRO	<b>Motor code:</b>	201100L	<b>Motor T.H.:</b>	YES IN
<b>Test nr.:</b>	1331	<b>Motor power [W]:</b>	1000	<b>Capacitor [<math>\mu</math>F]:</b>	30
<b>Date:</b>	2015/05/29	<b>Motor poles:</b>	4	<b>Fan max. abs. current [A]:</b>	5.6
<b>Power supply[V]:</b>	230 1~	<b>Mot. prot. class:</b>	IP 54		
<b>Frequency [Hz]:</b>	50	<b>Mot. ins. class:</b>	F		

