


Air density (γ): 1.20 kg/m³
 Installation type "A": free inlet, free outlet
 12000 m³/h fan test chamber according to AMCA 210/05 fig. 12
 Free field Lp(A) measurements at 1 m according to ISO 3746:2011

Fan type:	VDI 8000 PRO	Motor code:	201101U	Motor T.H.:	YES OUT
Test nr.:	2929	Motor power [W]:	1000	Capacitor [μF]:	-
Date:	2018/06/06	Motor poles:	4	Fan max. abs. current [A]:	3,8/2,2
Power supply[V]:	230/400 3~	Mot. prot. class:	IP54	Fan max. abs. power [W]:	1180
Frequency [Hz]:	50	Mot. ins. class:	F		

ErP status: Not subjected to ErP Regulation

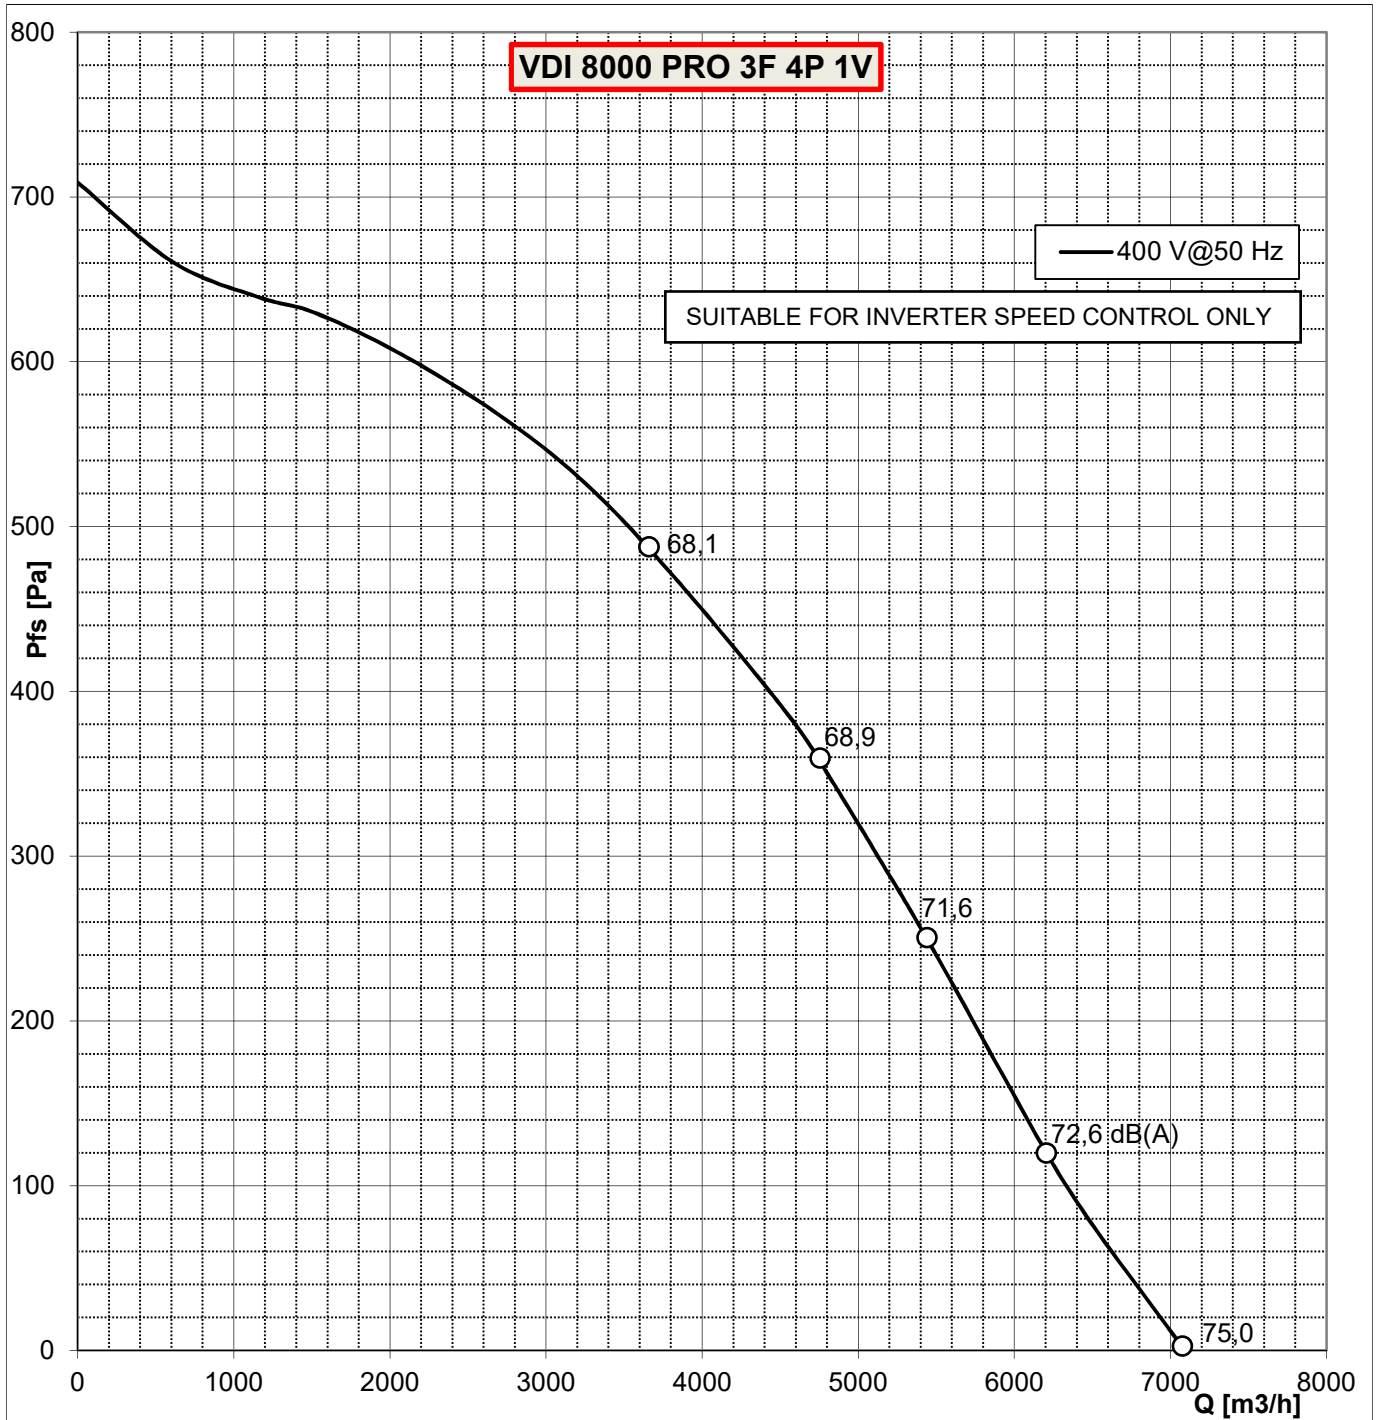

Air density (γ): 1.20 kg/m³
Installation type "A": free inlet, free outlet
12000 m³/h fan test chamber according to AMCA 210/05 fig. 12
Free field Lp(A) measurements at 1 m according to ISO 3746:2011

Fan type:	VDI 8000 PRO	Motor code:	201101U	Motor T.H.:	YES OUT
Test nr.:	2929	Motor power [W]:	1000	Capacitor [μ F]:	-
Date:	2018/06/06	Motor poles:	4	Fan max. abs. current [A]:	3,8/2,2
Power supply[V]:	230/400 3~	Mot. prot. class:	IP54	Fan max. abs. power [W]:	1180
Frequency [Hz]:	50	Mot. ins. class:	F		

ErP status: Not subjected to ErP Regulation

