


Air density (γ): 1.20 kg/m³
Installation type "B": free inlet, ducted outlet
12000 m³/h fan test chamber according to AMCA 210/05 fig. 12
Free-field Lp(A) measurements at 1 m according to ISO 3746:2011

Unit type:		Motor code:	2031008	Motor T.H.:	YES IN
Test nr.:	2699	Motor power [W]:	300	Capacitor [μF]:	10
Date:	2017/12/21	Motor poles:	4	Unit max. abs. current [A]:	2,3
Power supply[V]:	230 1~	Mot. prot. class:	IP44	Unit max. abs. power [W]:	510
Frequency [Hz]:	50	Mot. ins. class:	F		

ErP status: ErP 2018

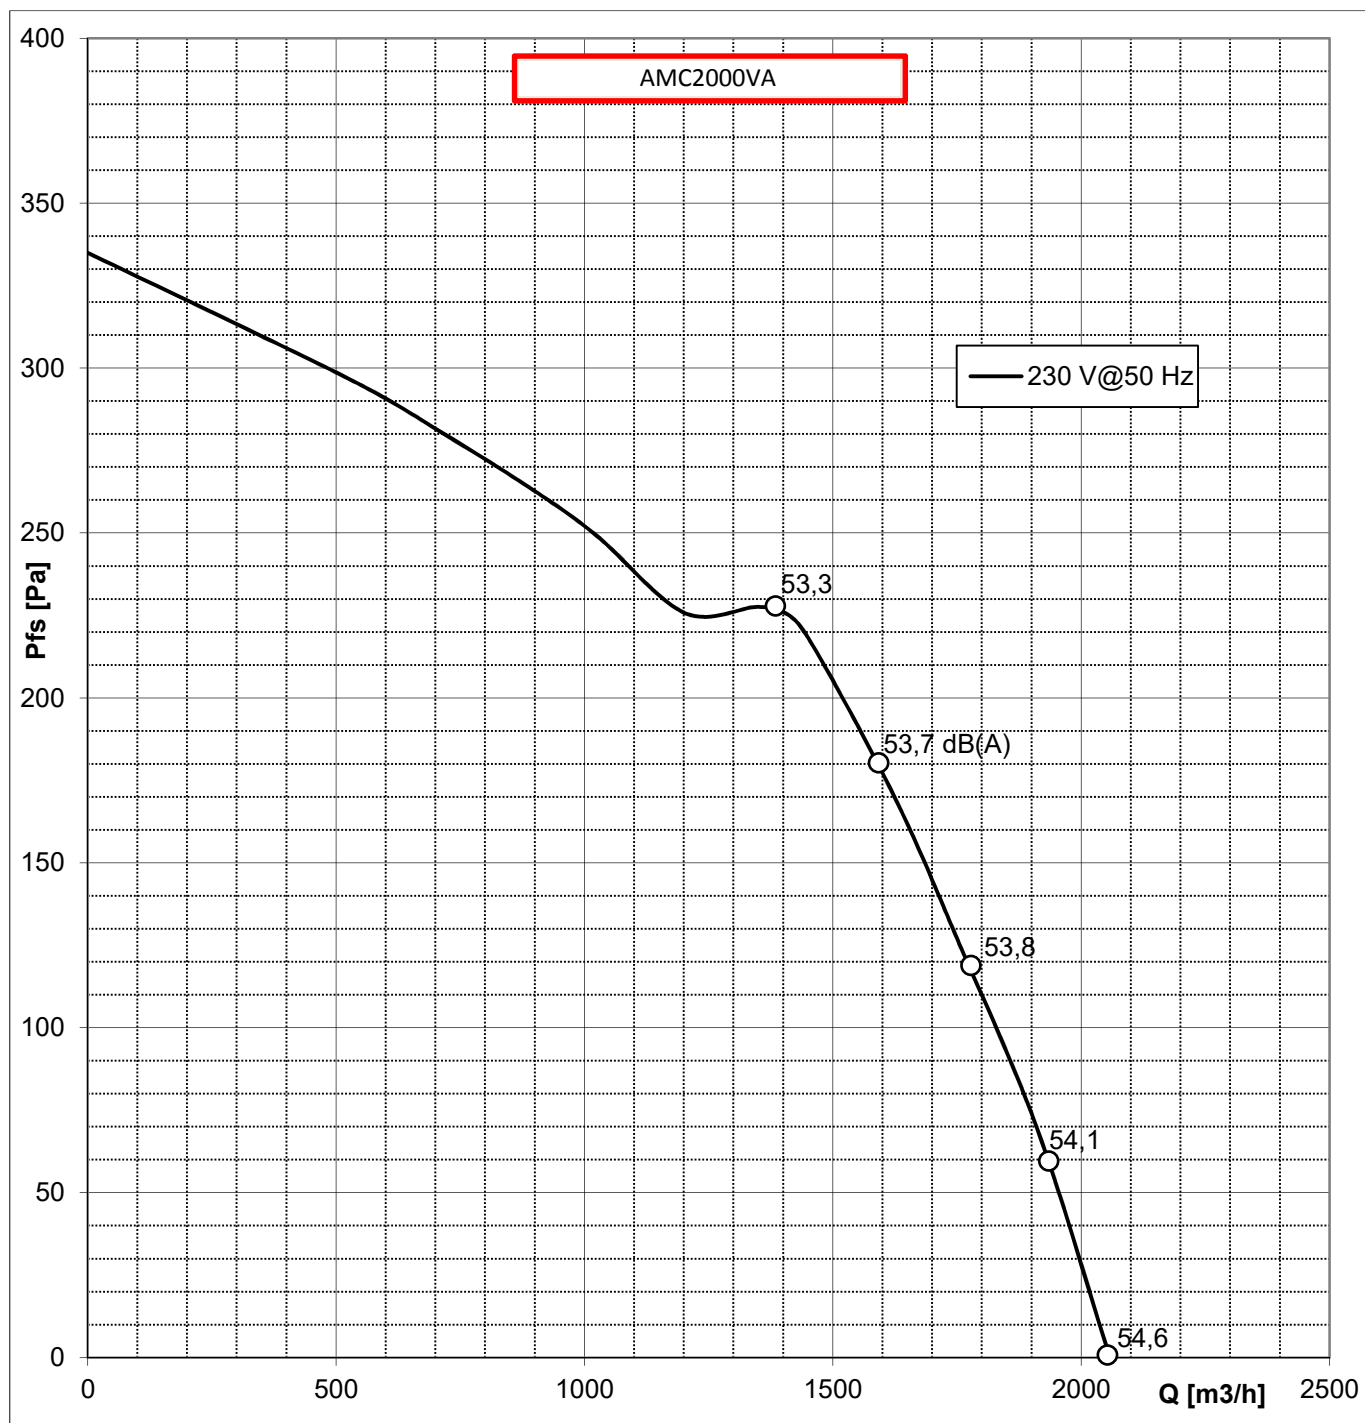

Data are not certified by AMCA

Air density (γ): 1.20 kg/m³
Installation type "B": free inlet, ducted outlet
12000 m³/h fan test chamber according to AMCA 210/05 fig. 12
Free-field Lp(A) measurements at 1 m according to ISO 3746:2011

Unit type:
Test nr.: 2699
Date: 2017/12/21
Power supply[V]: 230 1~
Frequency [Hz]: 50

Motor code: 2031008
Motor power [W]: 300
Motor poles: 4
Mot. prot. class: IP44
Mot. ins. class: F

Motor T.H.: YES IN
Capacitor [μ F]: 10
Unit max. abs. current [A]: 2,3
Unit max. abs. power [W]: 510

ErP status: ErP 2018

