


Air density (γ): 1.20 kg/m³
Installation type "B": free inlet, ducted outlet
12000 m³/h fan test chamber according to AMCA 210/05 fig. 12
Free-field Lp(A) measurements at 1 m according to ISO 3746:2011

Unit type:
Test nr.: 2781
Date: 2018/03/05
Power supply[V]: 230 1~
Frequency [Hz]: 50

Motor code: 201101Q
Motor power [W]: 550
Motor poles: 4
Mot. prot. class: IP44
Mot. ins. class: F

Motor T.H.: YES IN
Capacitor [μ F]: 12,5
Unit max. abs. current [A]: 4
Unit max. abs. power [W]: 900

ErP status: ErP 2018

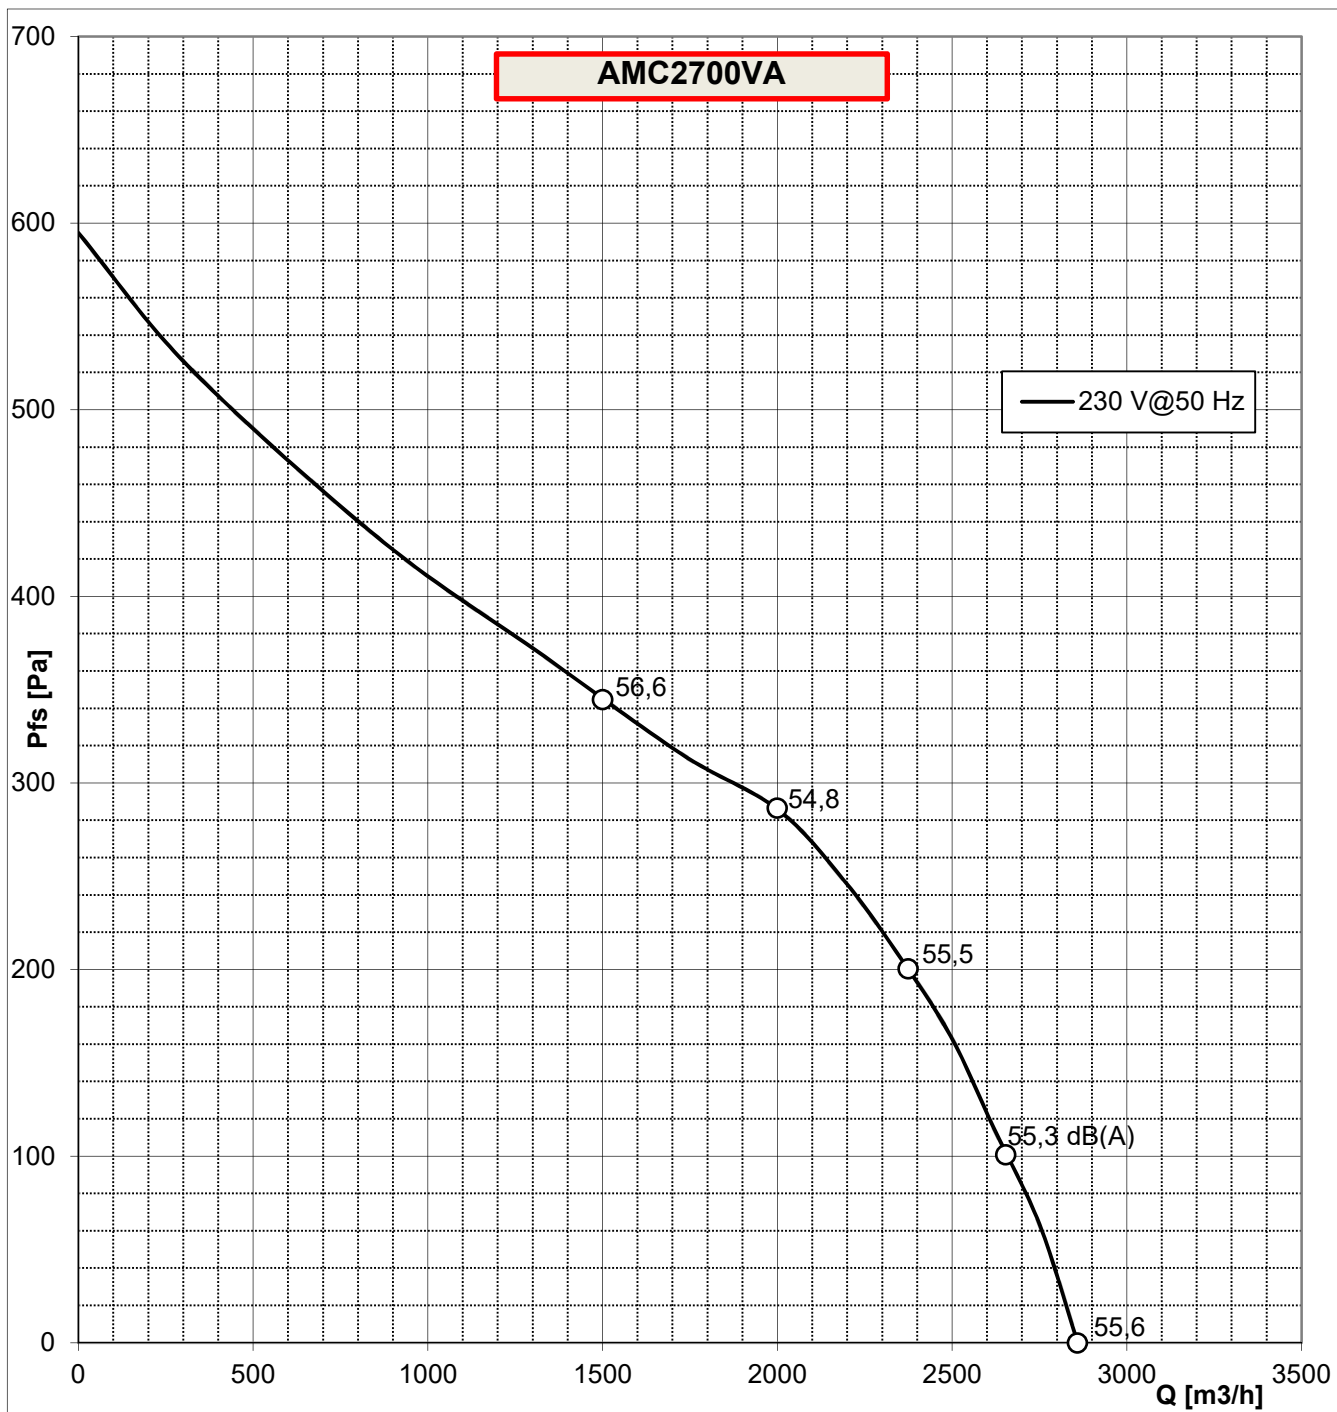

Data are not certified by AMCA

Air density (γ): 1.20 kg/m³
 Installation type "B": free inlet, ducted outlet
 12000 m³/h fan test chamber according to AMCA 210/05 fig. 12
 Free-field Lp(A) measurements at 1 m according to ISO 3746:2011

Unit type:
 Test nr.: 2781
 Date: 2018/03/05
 Power supply[V]: 230 1~
 Frequency [Hz]: 50

Motor code: 201101Q
 Motor power [W]: 550
 Motor poles: 4
 Mot. prot. class: IP44
 Mot. ins. class: F

Motor T.H.: YES IN
 Capacitor [μ F]: 12,5
 Unit max. abs. current [A]: 4
 Unit max. abs. power [W]: 900

ErP status: ErP 2018

