


Air density (γ): 1.20 kg/m³
Installation type "B": free inlet, ducted outlet
12000 m³/h fan test chamber according to AMCA 210/05 fig. 12
Free field Lp(A) measurements at 1 m according to ISO 3746:2011

Unit type:
Test nr.: 2961
Date: 2018/07/03
Power supply[V]: 400/230 3~
Frequency [Hz]: 50

Motor code: 201100P
Motor power [W]: 1100
Motor poles: 6
Mot. prot. class: IP55
Mot. ins. class: F

Motor T.H.: YES OUT
Capacitor [μ F]: -
Unit max. abs. current [A]: 3,2/5,5
Unit max. abs. power [W]: 1200

ErP status: ErP 2018

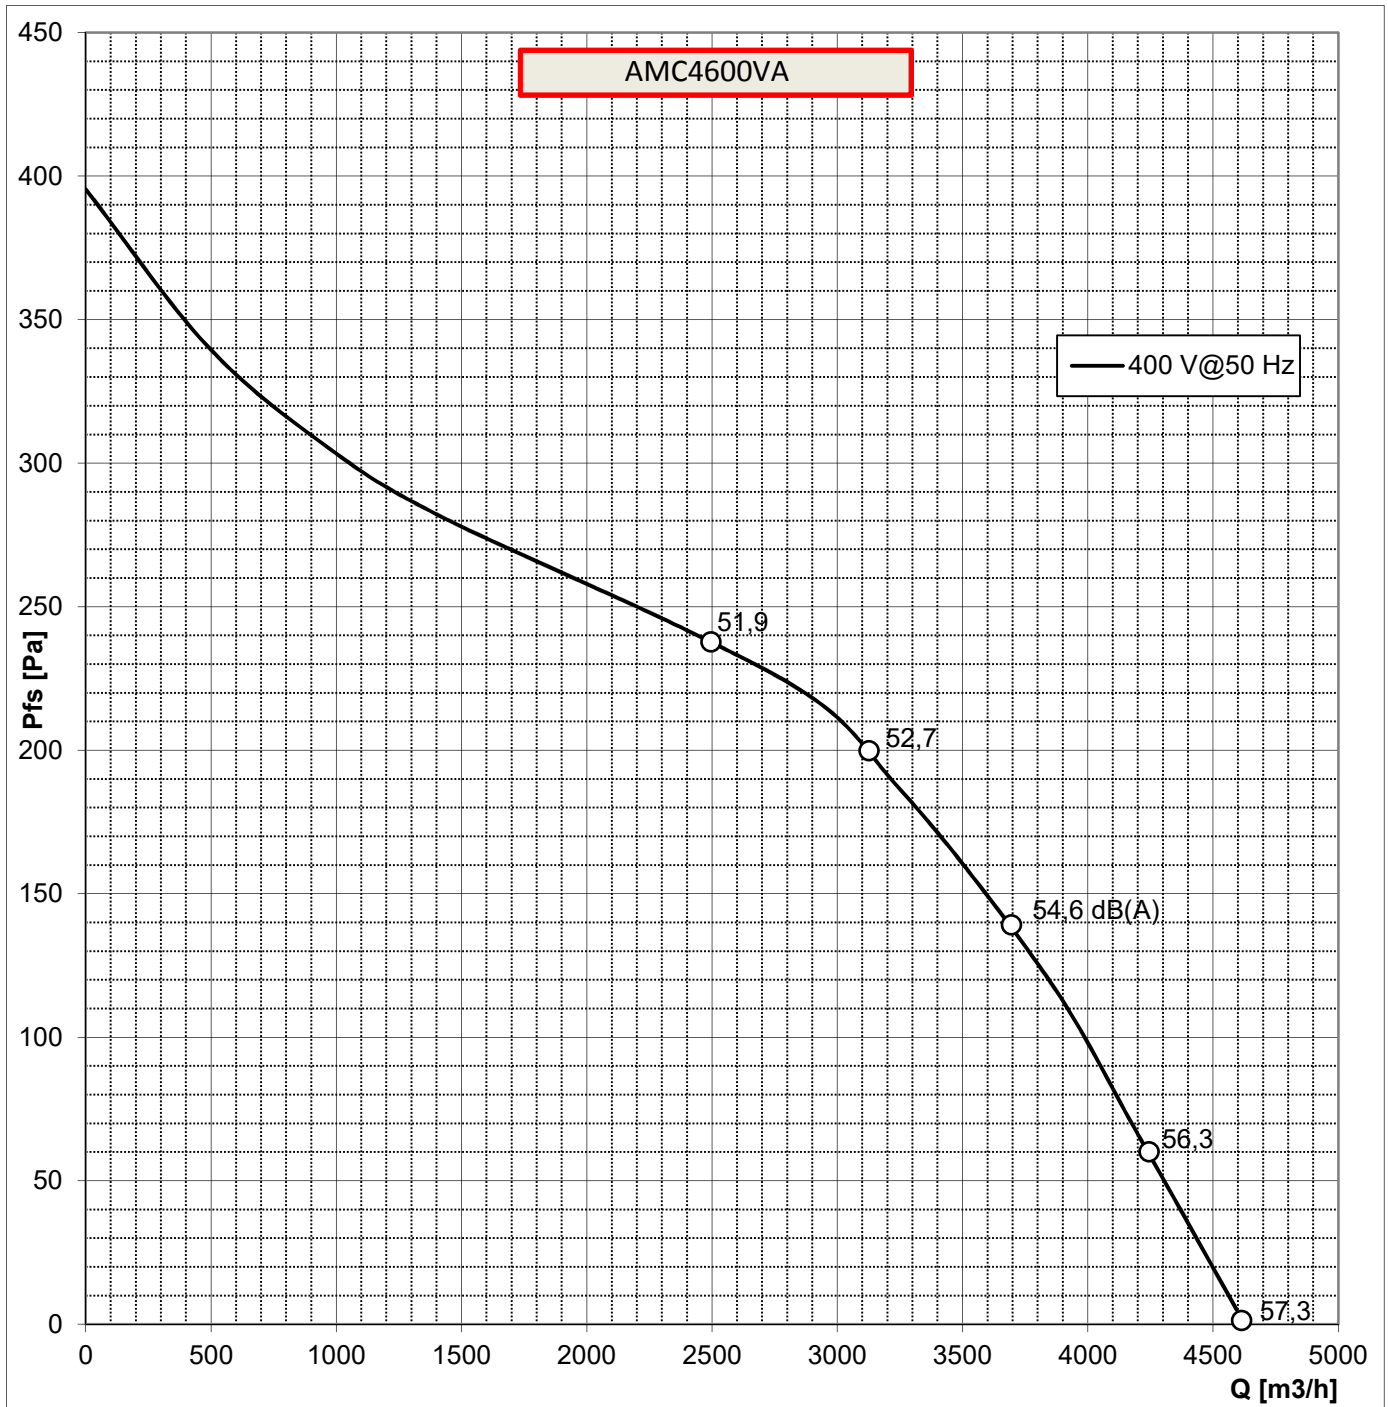

Data are not certified by AMCA

Air density (γ): 1.20 kg/m³
Installation type "B": free inlet, ducted outlet
12000 m³/h fan test chamber according to AMCA 210/05 fig. 12
Free field Lp(A) measurements at 1 m according to ISO 3746:2011

Unit type:		Motor code:	201100P	Motor T.H.:	YES OUT
Test nr.:	2961	Motor power [W]:	1100	Capacitor [μF]:	-
Date:	2018/07/03	Motor poles:	6	Unit max. abs. current [A]:	3,2/5,5
Power supply[V]:	400/230 3~	Mot. prot. class:	IP55	Unit max. abs. power [W]:	1200
Frequency [Hz]:	50	Mot. ins. class:	F		

ErP status: ErP 2018

