


Air density (γ): 1.20 kg/m³
 Installation type "B": free inlet, ducted outlet
 12000 m³/h fan test chamber according to AMCA 210/05 fig. 12
 Free-field Lp(A) measurements at 1 m according to ISO 3746:2011

Unit type:	CBT 6000VT X18	Motor code:	MTR.B3.1,5	Motor T.H.:	NO
Test nr.:	2641	Motor power [W]:	1500	Capacitor [μF]:	-
Date:	2017/10/24	Motor poles:	4	Unit max. abs. current [A]:	3,2/5,5
Power supply[V]:	400/230 3~	Mot. prot. class:	IP55	Unit max. abs. power [W]:	1640
Frequency [Hz]:	50	Mot. ins. class:	F		

tatus: ErP 2018

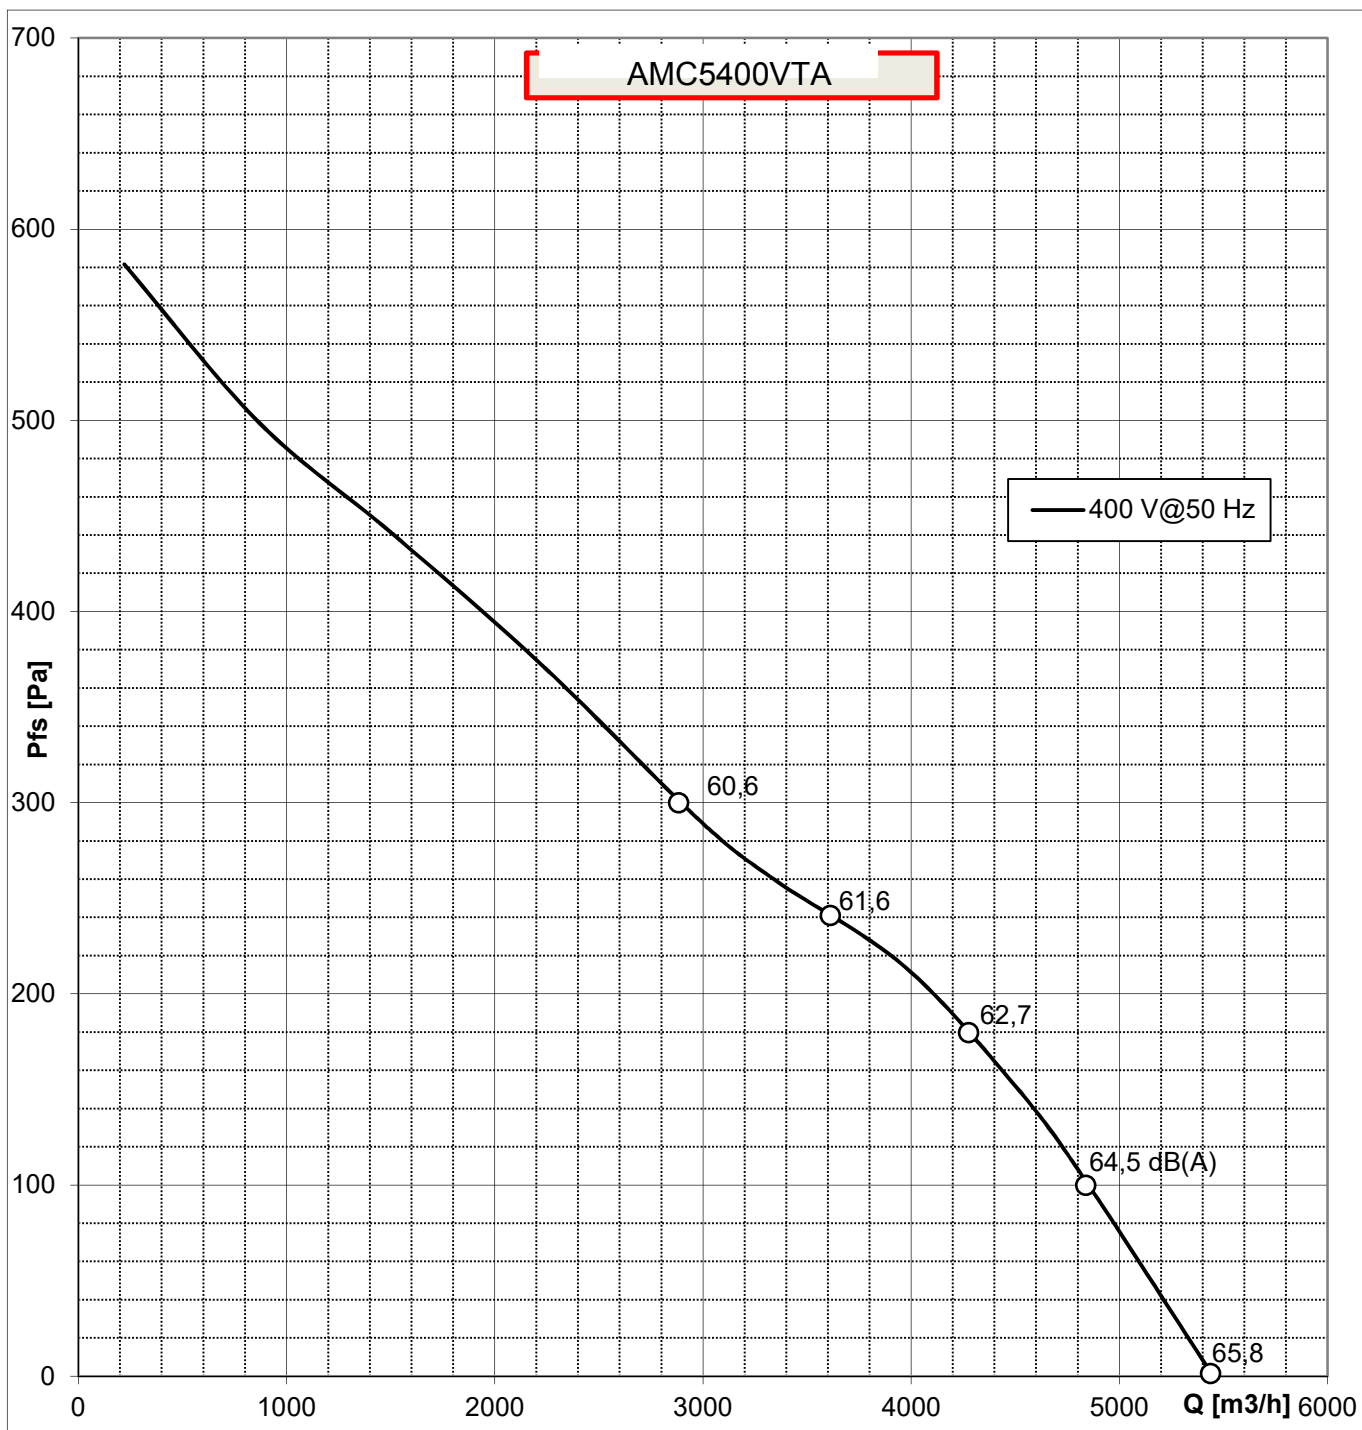

Data are not certified by AMCA

Air density (γ): 1.20 kg/m³
 Installation type "B": free inlet, ducted outlet
 12000 m³/h fan test chamber according to AMCA 210/05 fig. 12
 Free-field Lp(A) measurements at 1 m according to ISO 3746:2011

Unit type:		Motor code:	MTR.B3.1,5	Motor T.H.:	NO
Test nr.:	2641	Motor power [W]:	1500	Capacitor [μF]:	-
Date:	2017/10/24	Motor poles:	4	Unit max. abs. current [A]:	3,2/5,5
Power supply[V]:	400/230 3~	Mot. prot. class:	IP55	Unit max. abs. power [W]:	1640
Frequency [Hz]:	50	Mot. ins. class:	F		

ErP status: ErP 2018

