


Air density (γ): 1.20 kg/m³
 Installation type "B": free inlet, ducted outlet
 12000 m³/h fan test chamber according to AMCA 210/05 fig. 12
 Free-field Lp(A) measurements at 1 m according to ISO 3746:2011

Unit type:
 Test nr.: 2962
 Date: 2018/07/03
 Power supply[V]: 400/230 3~
 Frequency [Hz]: 50

Motor code: 201100V
 Motor power [W]: 1500
 Motor poles: 4
 Mot. prot. class: IP20
 Mot. ins. class: F

Motor T.H.: YES OUT
 Capacitor [μ F]: -
 Unit max. abs. current [A]: 6/10,4
 Unit max. abs. power [W]: 3500

ErP status: ErP 2018

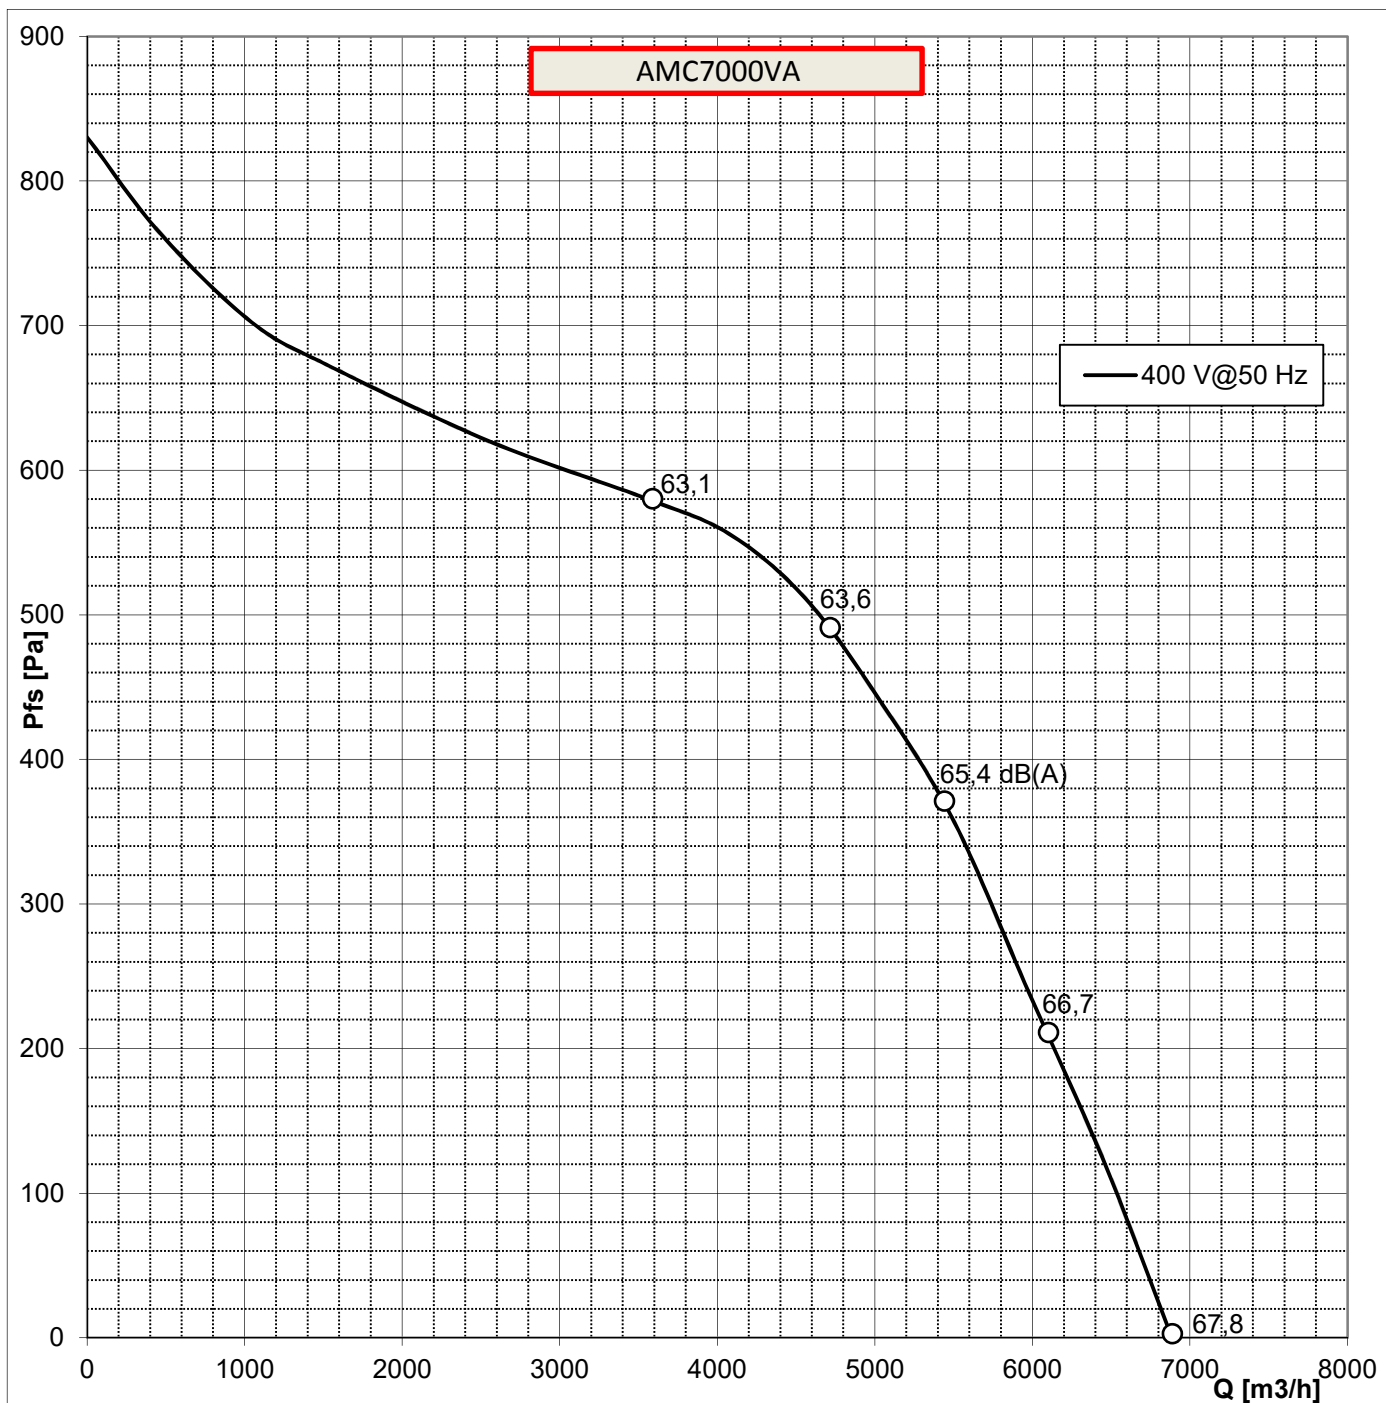

Data are not certified by AMCA

Air density (γ): 1.20 kg/m³
 Installation type "B": free inlet, ducted outlet
 12000 m³/h fan test chamber according to AMCA 210/05 fig. 12
 Free-field Lp(A) measurements at 1 m according to ISO 3746:2011

Unit type:		Motor code:	201100V	Motor T.H.:	YES OUT
Test nr.:	2962	Motor power [W]:	1500	Capacitor [μF]:	-
Date:	2018/07/03	Motor poles:	4	Unit max. abs. current [A]:	6/10,4
Power supply[V]:	400/230 3~	Mot. prot. class:	IP20	Unit max. abs. power [W]:	3500
Frequency [Hz]:	50	Mot. ins. class:	F		

ErP status: ErP 2018

